



PHENIX Rack Monitor & Control LAN Diagram

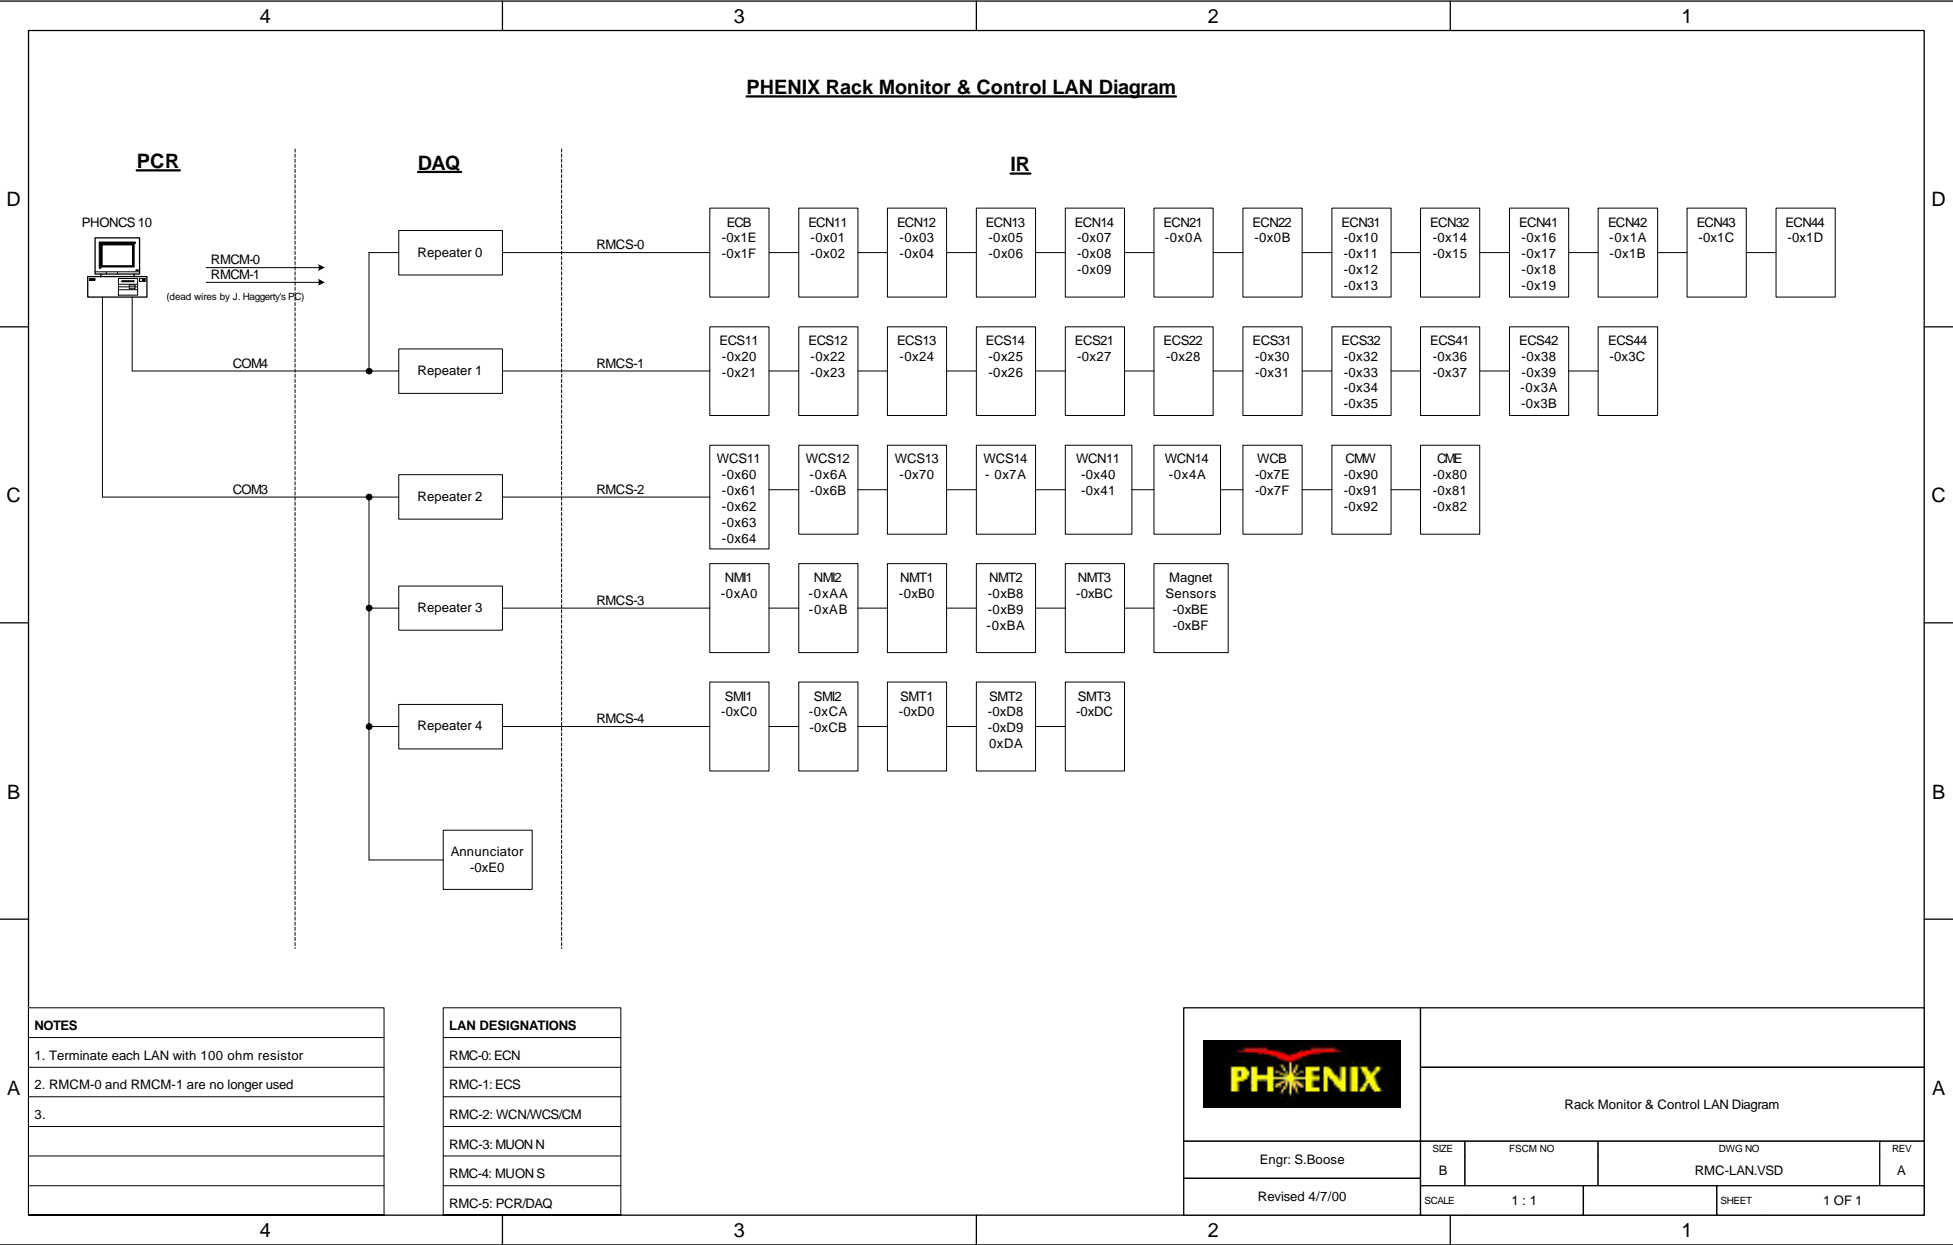

NOTES	
1.	Terminate each LAN with 100 ohm resistor
2.	RMC-M-0 and RMC-M-1 are no longer used
3.	

LAN DESIGNATIONS	
RMC-0:	ECN
RMC-1:	ECS
RMC-2:	WCN/WCS/CM
RMC-3:	MUON N
RMC-4:	MUON S
RMC-5:	PCR/DAQ

				Rack Monitor & Control LAN Diagram			
Engr: S.Boose		SIZE	FSCM NO	DWG NO	REV		
Revised 4/7/00		B		RMC-LAN.VSD	A		
		SCALE	1 : 1	SHEET	1 OF 1		